


- CONSTRUCTION TYPE V-N OCCUPANCY CLASSIFICATION B 2
 Maximum Occupants - 90
- FIRE DEPARTMENT REQUIREMENTS**
1. The required fire flow for this location is 1500 gallons per minute @ 20 psi for a duration of 2 hours, over and above maximum daily domestic demand.
 2. The inspection, hydrostatic test and flushing of the hydrant and/or sprinkler system shall be witnessed by the proper Fire Department representative and no underground piping shall be covered with earth or hidden from view until the Fire Department representative has been notified and given not less than 48 hours in which to inspect such installation.
 3. Fire protection facilities, including access, must be provided prior to and during construction.
 4. Exit signs must be posted at each exit.
 5. Sign shall be posted indicating that doors are to remain open and unlocked during all hours of occupancy.
 6. Fire extinguisher requirements (including U.L. approved ratings and locations) shall be determined by field inspection.

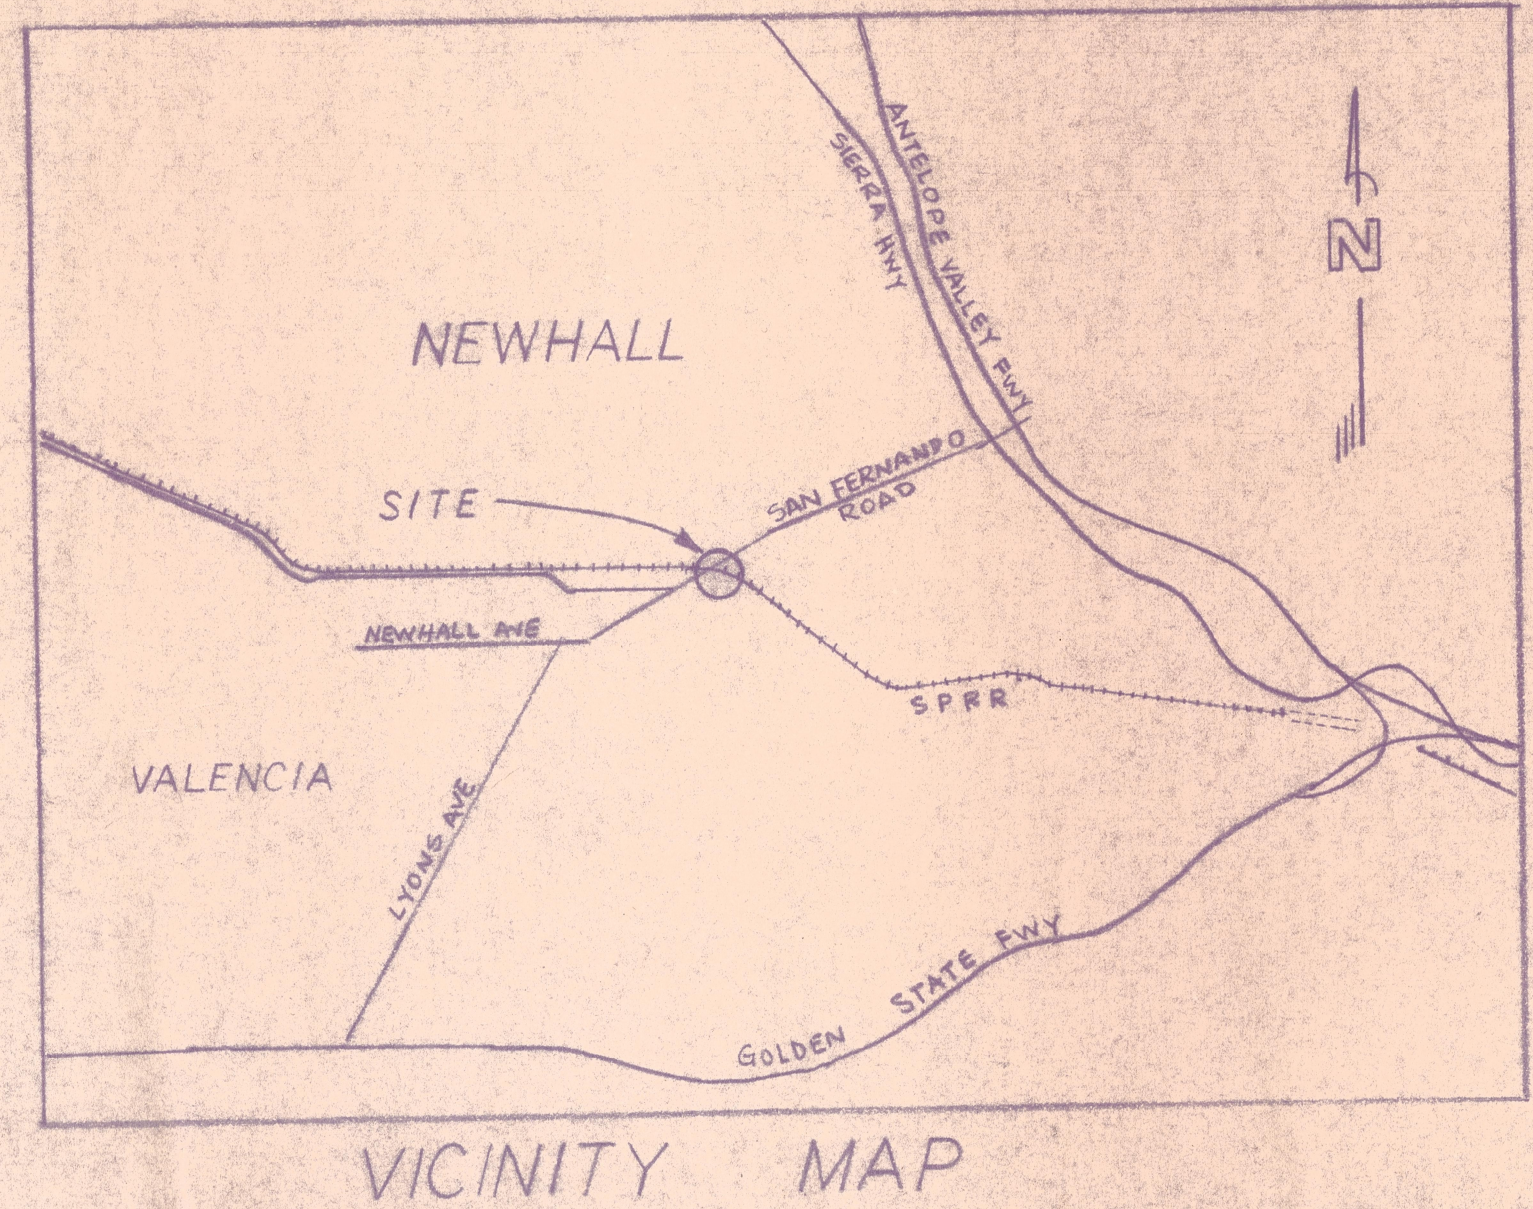

- PLOT PLAN -

CONTOURS FROM LOS ANGELES COUNTY SURVEY DIVISION
 JOB NUMBER 0755.34

REVISIONS	BY
4/20/80 ADDED SEPTIC	DEH
5/30/80 MOVED SEPTIC SYSTEM & MOVED FIRE HYDRANT	DEH

SANTA CLARITA VALLEY HISTORICAL SOCIETY
 SAUGUS DEPOT RELOCATION
 PROPOSED SITE DEVELOPMENT

HAHALE & ASSOCIATES INC.
CONSULTING ENGINEERS
 23922 AVENIDA CRESCENTA, VALENCIA, CA
 805 259-9702

Date 3-19-80
 Scale 1"=20'-0"
 Drawn DEH
 Job 8003016
 Sheet 3
 Of 3 Sheets